

15L 8 PUMP PANEL WITH JOCKEY PUMP



AAC Technical Services Ltd
 Unit 2, Brunel Business Court
 Brunel Way, Thetford, Norfolk IP24 1HP

15L 8 PUMP PANEL WITH JOCKEY PUMP
 Cover page

| | | | | |
|-------------|------------|------|-------------|----------|
| | | | | REVISION |
| | | | | 0 |
| 0 | 30/07/2025 | TW | | SCHEME |
| REV. | DATE | NAME | CHANGES | |
| User data 1 | | | User data 2 | 01 |

CONTRACT: XCELL MISTING 2496

LOCATION: +L1

Main electrical closet

1-15L 8 PUMP PANEL WITH JOCKEY PUMP

| Drawing | Description | Function | Location | Revision | Date | Created by |
|--------------------|------------------------|----------|----------|----------|------------|------------|
| 01 | Cover page | =F1 | +L1 | 0 | 30/07/2025 | TW |
| 02 | Drawings list | =F1 | +L1 | 0 | 30/07/2025 | TW |
| 03 | POWER DISTRIBUTION | =F1 | +L1 | 0 | 30/07/2025 | TW |
| 06 | PUMP POWER | =F1 | +L1 | 0 | 02/08/2025 | TW |
| 07 | CONTROL CIRCUIT 1 OF 2 | =F1 | +L1 | 0 | 02/08/2025 | TW |
| 08 | CONTROL CIRCUIT 2 OF 2 | =F1 | +L1 | 0 | 02/08/2025 | TW |
| 05 | BMS | =F1 | +L1 | 0 | 30/07/2025 | TW |




AAC Technical Services Ltd
 Unit 2, Brunel Business Court
 Brunel Way, Thetford, Norfolk IP24 1HP

15L 8 PUMP PANEL WITH JOCKEY PUMP
 Drawings list

CONTRACT: XCELL MISTING 2496

LOCATION: +L1 Main electrical closet

| | | | | |
|-------------|------------|------|-------------|----------|
| | | | | REVISION |
| | | | | 0 |
| 0 | 30/07/2025 | TW | | SCHEME |
| REV. | DATE | NAME | CHANGES | |
| User data 1 | | | User data 2 | 02 |

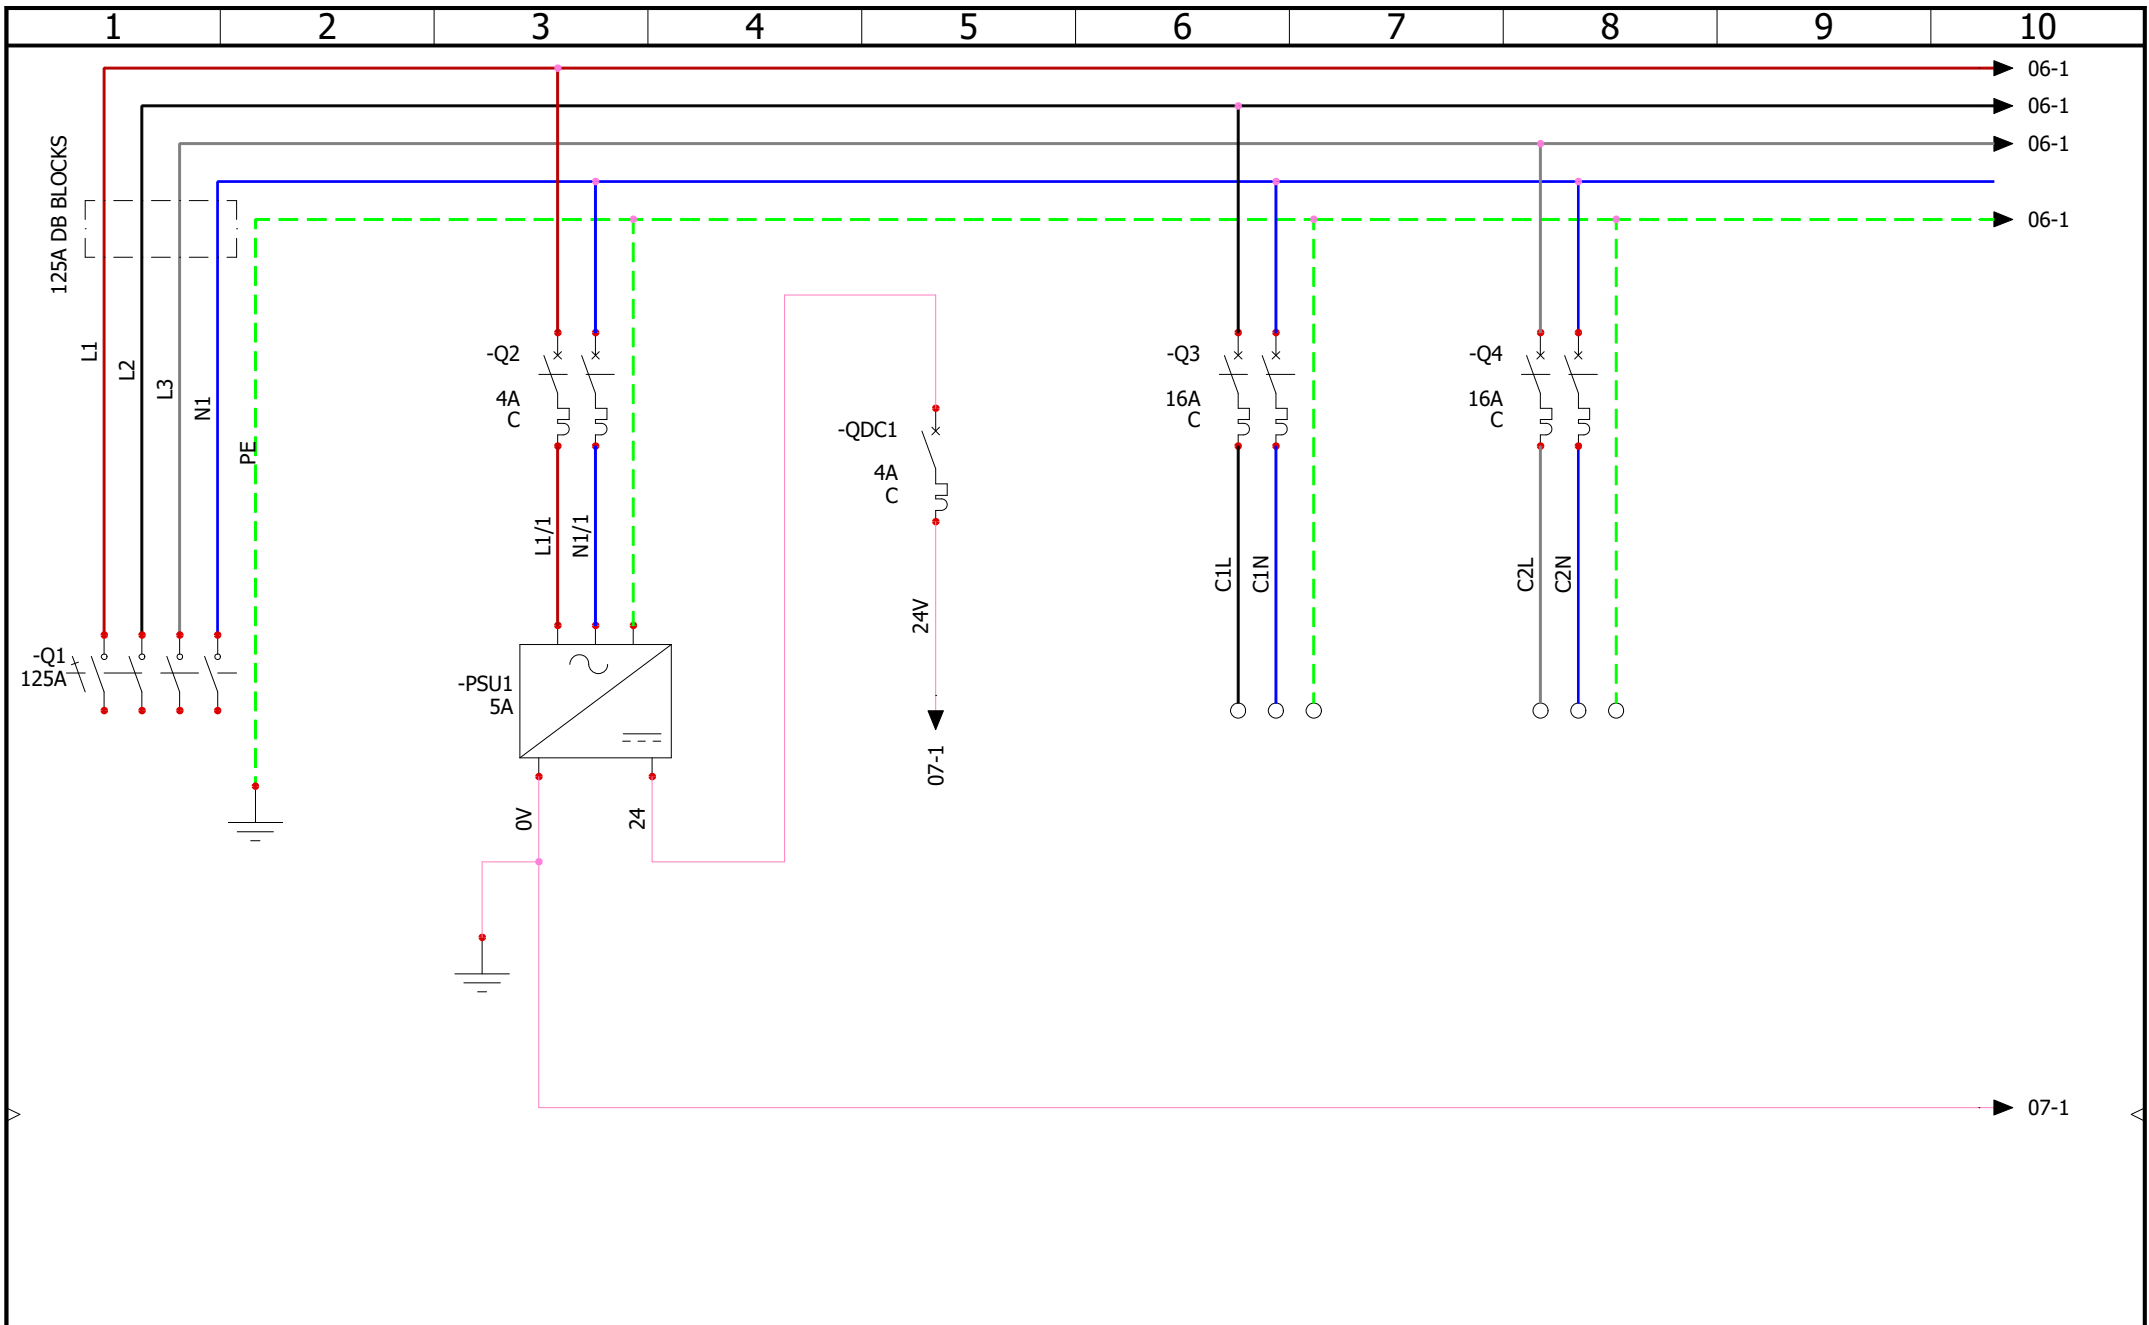

AAC Technical Services Ltd
 Unit 2, Brunel Business Court
 Brunel Way, Thetford, Norfolk IP24 1HP

CONTRACT: XCELL MISTING 2496


**15L 8 PUMP PANEL WITH JOCKEY PUMP
 POWER DISTRIBUTION**

LOCATION: +L1

Main electrical closet

| REV. | DATE | NAME | CHANGES | REVISION |
|------|------------|------|---------|----------|
| 0 | 30/07/2025 | TW | | 0 |
| | | | | SCHEME |
| | | | | 03 |

User data 1: _____ User data 2: _____

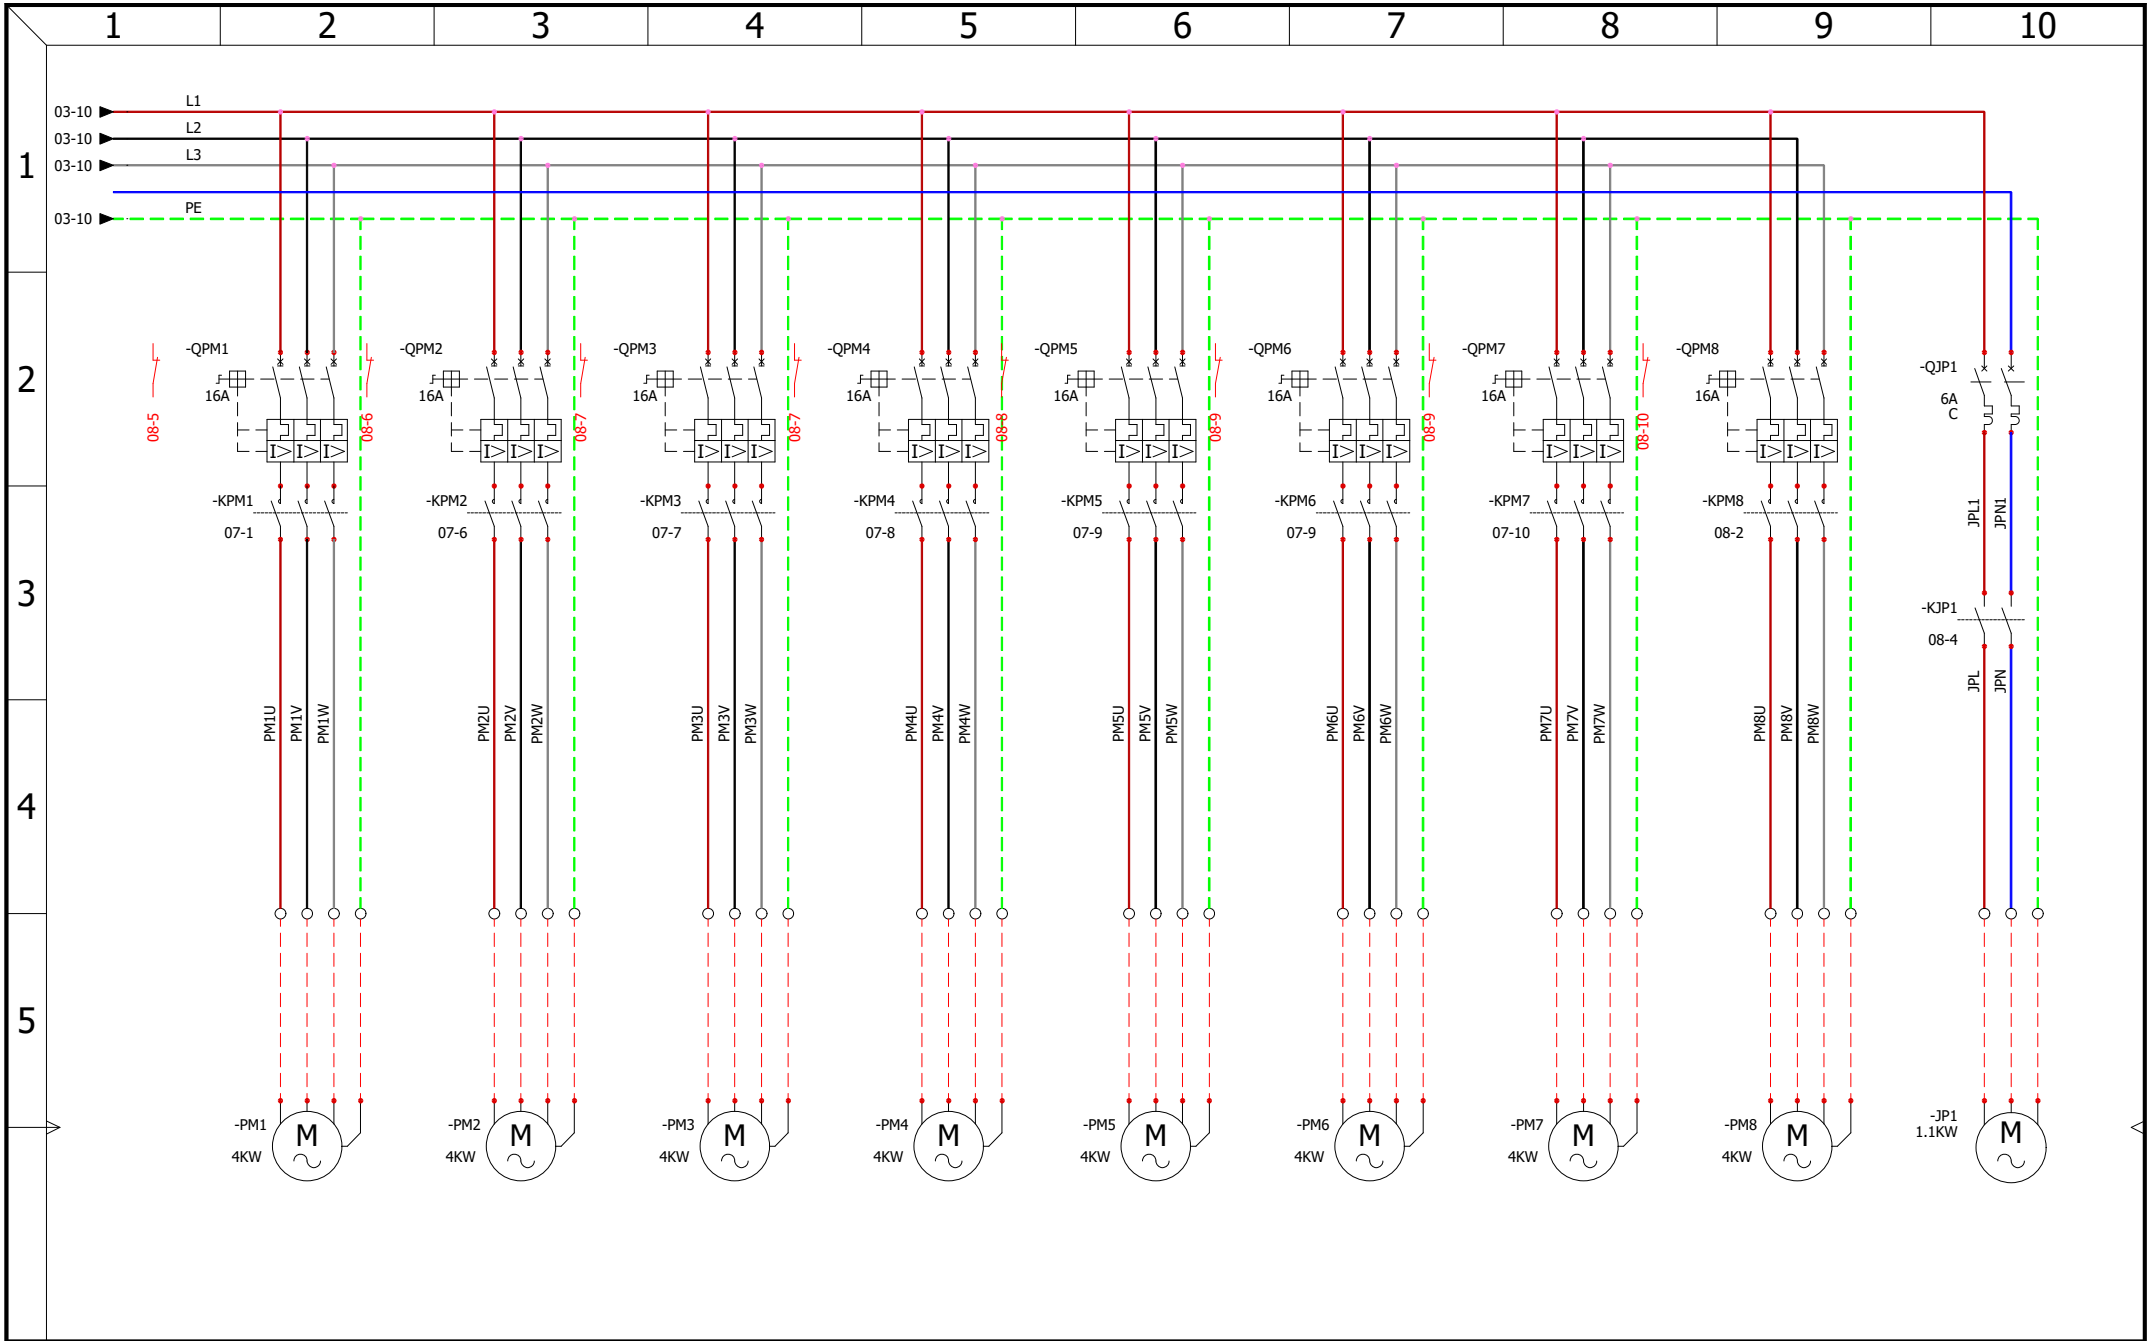

C:\Users\Paul\Documents\My Customers\XCELL\logo.jpg

21 Penfold Drive
Wymondham
Norwich, Norfolk
NR18 0WZ

PUMP POWER

REVISION

0

0 02/08/2025 TW

REV. DATE NAME

CHANGES

SHEET


OF

User data 1

User data 2


4

7

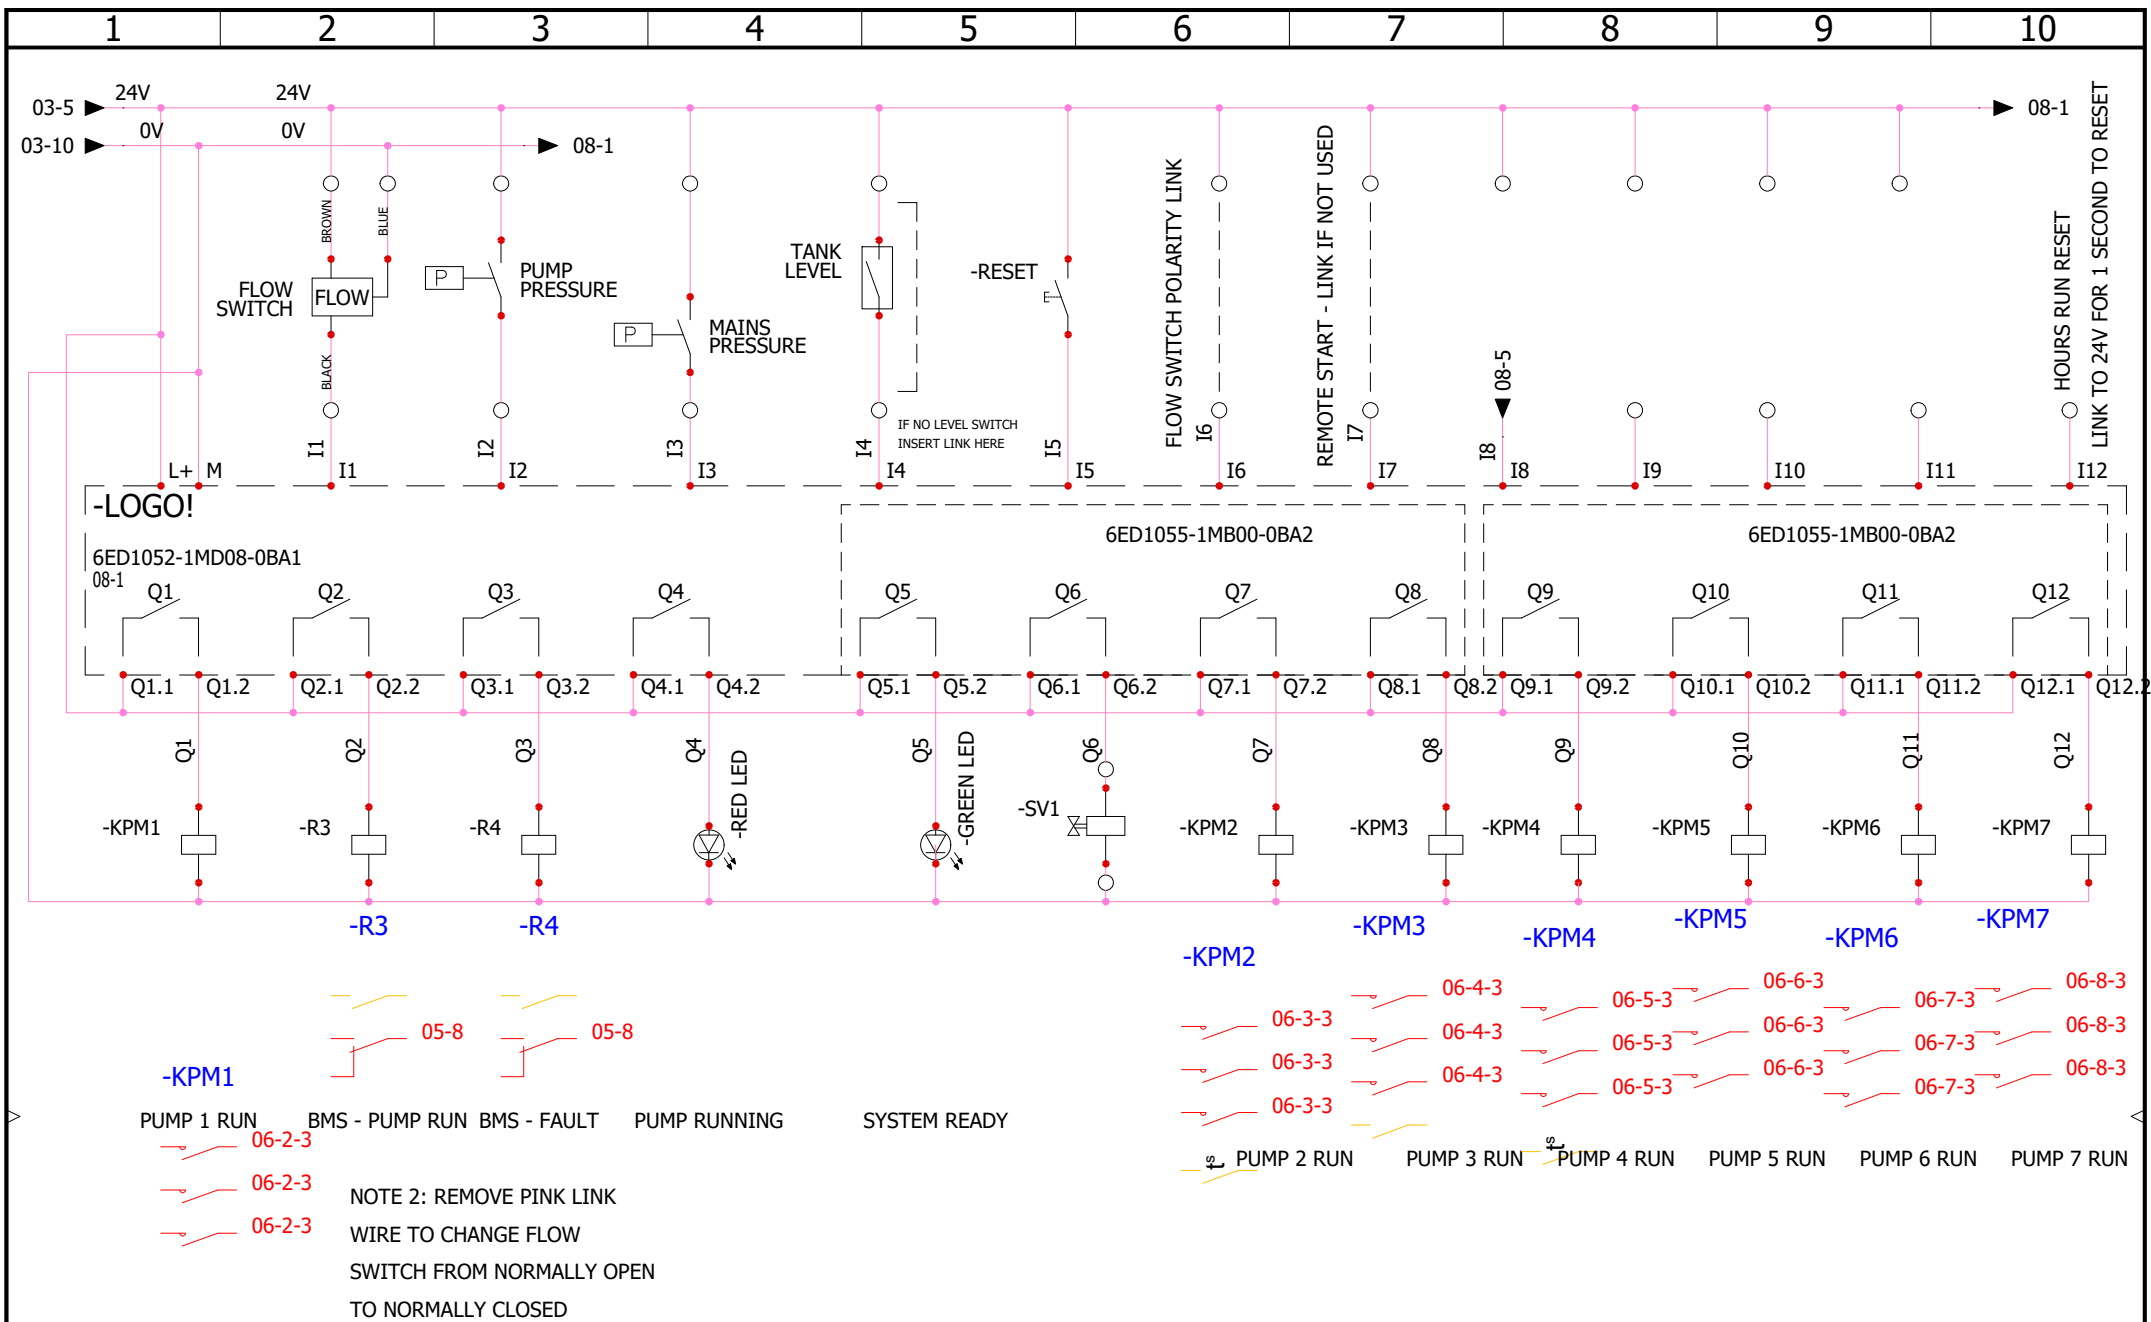

| | | | | | |
|--|---|--------------------|--|-----------|----------------------------|
| AAC Technical Services Ltd Unit 2, Brunel Business Court Brunel Way, Thetford, Norfolk IP24 1HP | 15L 8 PUMP PANEL WITH JOCKEY PUMP CONTROL CIRCUIT 1 OF 2 | | | REVISION | 0 |
| | | | | REV. | DATE |
| | CONTRACT: | XCELL MISTING 2496 | | LOCATION: | +L1 Main electrical closet |

| | | | |
|-------------|------------|-------------|---------|
| 0 | 02/08/2025 | TW | |
| REV. | DATE | NAME | CHANGES |
| User data 1 | | User data 2 | |

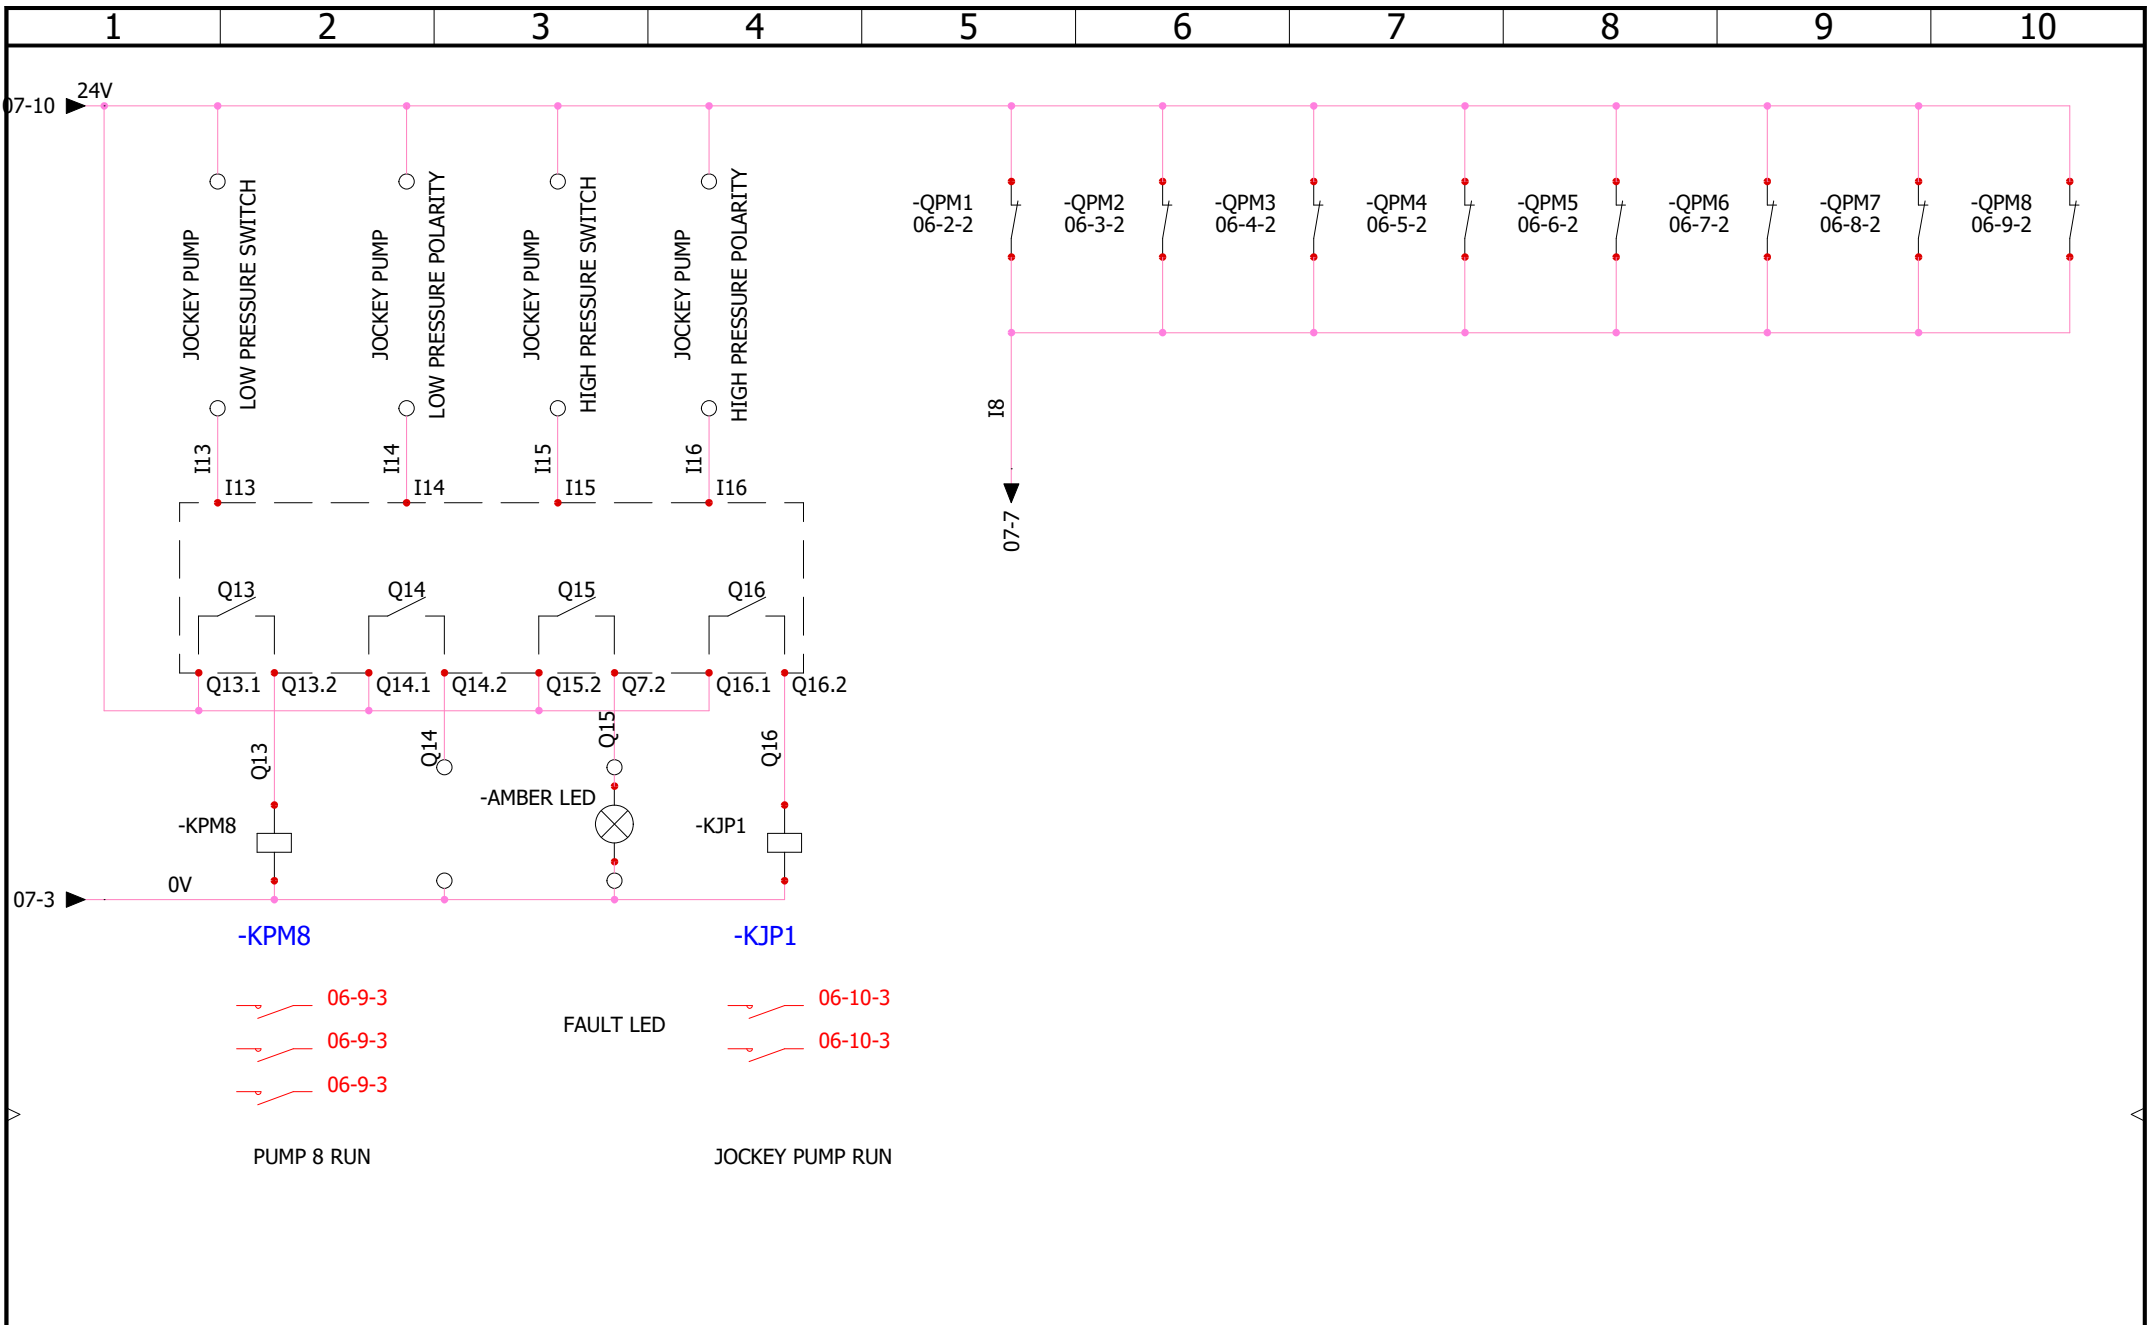

AAC Technical Services Ltd
 Unit 2, Brunel Business Court
 Brunel Way, Thetford, Norfolk IP24 1HP

15L 8 PUMP PANEL WITH JOCKEY PUMP
CONTROL CIRCUIT 2 OF 2

CONTRACT: XCELL MISTING 2496

LOCATION: +L1

Main electrical closet

| | | | | |
|-------------|------------|------|-------------|----------|
| | | | | REVISION |
| | | | | 0 |
| 0 | 02/08/2025 | TW | | |
| REV. | DATE | NAME | CHANGES | SCHEME |
| | | | | 08 |
| User data 1 | | | User data 2 | |

1

2

3

4

5


6

7


8

9

10

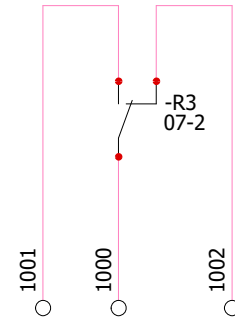

BMS - PUMP RUNNING

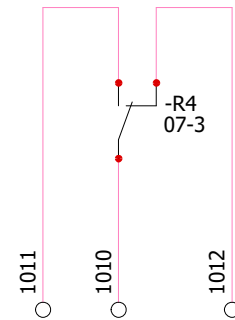

BMS - FAULT



AAC Technical Services Ltd
 Unit 2, Brunel Business Court
 Brunel Way, Thetford, Norfolk IP24 1HP

15L 8 PUMP PANEL WITH JOCKEY PUMP
BMS

CONTRACT: XCELL MISTING 2496

LOCATION: +L1

Main electrical closet

| | | | | REVISION |
|-------------|------------|------|-------------|----------|
| | | | | 0 |
| 0 | 30/07/2025 | TW | | |
| REV. | DATE | NAME | CHANGES | SCHEME |
| | | | | 05 |
| User data 1 | | | User data 2 | |